

INSTALLATION MANUAL

AIR CONDITIONER

Please read this installation manual completely before installing the product.
Installation work must be performed in accordance with the national wiring standards by authorized personnel only.
Please retain this installation manual for future reference after reading it thoroughly.

PRDSBM



P/NO : MFL67525609

ENGLISH	ITALIANO	ESPAÑOL	FRANÇAIS	DEUTSCH	ΕΛΛΗΝΙΚΑ	ČEŠTINA	NEDERLANDS	POLSKI	LIMBA ROMÂNĂ
PORTUGUESE	MAGYAR	БЪЛГАРСКИ	SRPSKI	HRVATSKI	SVENDKA	NORSK	SUOMI	DANSK	EESTI KEEL
MALTI	SLOVENČINA	SLOVENŠČINA	LATVIĒŠU VALODA	LIETUVIŲ KALBA	GAEILGE	МАКЕДОНСКИ	SHQIP	ÍSLENSKA	BOSANSKI

Outdoor Dry Contact (PRDSBM) Installation Manual

1. Check the contents of Outdoor Dry Contact(PRDSBM).




<Outdoor Dry Contact Main Body>



<Front Case>

2. Connect Outdoor Main PCB and Outdoor Dry Contact


- Connect terminals(DRY1, DRY2, GND) on the back side of the outdoor dry contact to terminals (DRY1, DRY2, GND) of outdoor as show below.

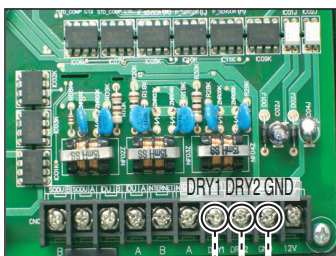

< Outdoor Main PCB >

..... shows field wiring

—— connected wiring

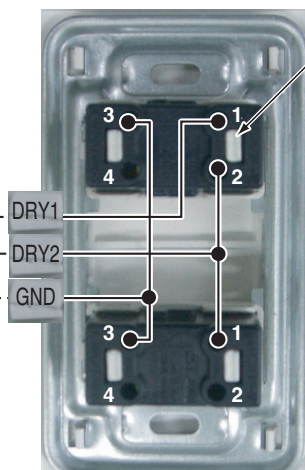

<Outdoor Dry Contact Back Side >

Push Button

- Insert wire method -

Push arrow direction.


Insert wire to connector.

* Communication line length can be maximum 300m, use communication line as thick as 1.25mm².

! CAUTION

Pay attention to the wiring when the Push Button on the back side of Outdoor Dry Contact is pressed and the wires are pulled out.

3. Outdoor dry contact combines with switch box as shown below

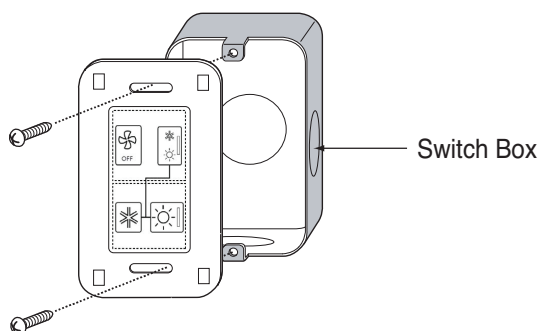

4. Attach the front case



Representative: LG Electronics Inc. EU Representative, Krijgsman 1, 1186 DM Am-
stelveen, The Netherlands
Manufacturer: LG Electronics Inc. Changwon 2nd factory, 84, Wanam-ro, Seongsan-gu,
Changwon-si, Gyeongsangnam-do, KOREA